

Loss Minimization of Power Distribution Network using Distributed Generation

Rajni Prasad¹ Amit Gupta²

¹Research Scholar ²Professor

^{1,2}Gyan Ganga College of Technology, Jabalpur, India

Abstract— Distributed generation (DG) is an emerging concept in the power sector, which represents good alternatives for electricity supply instead of the traditional centralized power generation concept. Due to sharp increase in power demand, voltage instability & line overloading has become challenging problems for power engineers. Voltage collapse, unexpected line & generator outages & blackouts are the major problems associated with voltage instability. Reactive power unbalancing is the major cause of voltage instability. So that the problem of enhancing the voltage profile and decreasing power losses in electrical systems is a task that must be solved in an optimal way. This type of problem is in single phase & three phases. Therefore to improve & enhance the voltage profile & stability of the existing power system, FACTS devices and load flow analysis are the alternative solution. This paper describes a forward backward sweep method based approach for load flow analysis in radial distribution system to improve voltage stability and to minimize the transmission line losses considering cost function for entire power system planning. The proposed approach will be tested on IEEE -33 bus system.

Key words: Distributed Generation, Embedded Generation, Electricity, Forward-Backward Sweep Algorithm; Radial Distributed System

I. INTRODUCTION

The liberation of the energy market and the new conditions in the energy field are leading towards the finding of more efficient ways of energy production and management. The introduction of new ideas capable of evolving in the new conditions might lead to more suitable solutions compared to any possible malfunctions the new market model can create.

The electricity marketplace is undergoing a tremendous transformation as it moves towards a more competitive environment. The 'growing pains' of this transformation – price instability, an ageing infrastructure, changing regulatory environments – are causing both energy users and electric utilities to take another look at the benefits of distributed generation (DG). The combination of utility restructuring, technology evolutions, recent environmental policies provide the basis for DG to progress as an important energy option in the near future. Utility restructuring opens energy markets, allowing the customer to decide the energy provider, method of delivery, and attendant services. The market forces favour small, modular power technologies that can be installed rapidly in response to market signals.

A. Distributed Generation

Generally, the term Distributed or Distributed Generation refers to any electric power production technology that is integrated within distribution systems, close to the point of use. Distributed generators are connected to the medium or low voltage grid. They are not centrally planned and they are

typically smaller than 30 MW. A distributed electricity system is one in which small and micro generators are connected directly to factories, offices, and households and to lower voltage distribution networks. Electricity not demanded by the directly connected customers is fed into the active distribution network to meet demand elsewhere. Electricity storage systems may be utilised to store any excess generation. Large power stations and large-scale renewable, e.g. offshore wind remain connected to the high voltage transmission network providing national back up and ensure quality of supply. Again, storage may be utilised to accommodate the variable output of some forms of generation. Such a distributed electricity system both options require significant investments of time and money to increase capacity. Distributed generation complements central power by

- 1) Providing in many cases a relatively low capital cost response to incremental increases in power demand,
- 2) Avoiding T&D capacity upgrades by locating power where it is most needed, and
- 3) Having the flexibility to put power back into the grid at user sites.

Significant technological advances through decades of intensive research have yielded major improvements in the economic, operational, and environmental performance of small, modular gas-fueled power generation options.

B. Power Quality

The definition of power quality given in the IEEE dictionary originates in IEEE Std. 1100. Power quality is the concept of powering and grounding sensitive equipment in a manner that is suitable to the operation of that equipment. Despite this definition the term power quality is clearly used in a more generic way. Within the industry, other definitions or interpretations of power quality have been used, reflecting dissimilar points of view. Thus, this definition might not be exclusive, pending development of a broader agreement. A point of view of an equipment designer or producer might be that power quality is an ideal sinusoidal wave, with no variations in the voltage, and no noise present on the grounding system. Ultimately, a point of view of an end-user is that power quality or "quality power" is basically the power that works for whatsoever equipment the end-user is applying. While each hypothetical point of view has a clear difference, it is clear that none is properly focused.

An environment where the equipment designer or company clearly states the equipment wants, and the electrical utility engineer indicates the system delivery characteristics, and the end-user after that predicts and understands the equipment effective instability that will likely be encountered on a yearly basis is a better situation. This allows a cost validation to be performed by the end-user to either improve equipment operation by installing additional components or improve the electrical supply system through

installation of additional, or alteration of existing components.

Implementation & Results: The proposed method is implemented using MATLAB 2013b and tested for IEEE 33 bus system. Figure 1 shows the overall diagram of the IEEE 33 bus Test data system. In this system, bus 1 is considered as the slack bus, remaining buses are PQ buses. The buses are connected in loop thus it is considered as a power system that operates under 11 kV levels. The proposed method is tested for 200 KVA Base.

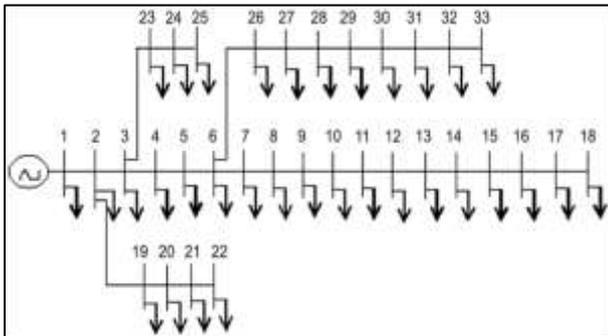


Fig. 1: Single Line Diagram for IEEE 33-bus Distribution Network

The proposed method is implemented using MATLAB 2013b and tested for IEEE 33 bus system. Which is shown in Figure 1 The optimal number of DGs to be connected in the system identified is found to be 2 for 3039.533 W & 369.5 W each rating. Table 1 shows the optimal capacity of Distributed Generation. It is clear that, the total Active power loss at without DG is 0.531(PU) and the total active power loss after connecting the optimal number of DGs in the system is 0.139(PU) Thus there is a reduction by about 39.92 % of total power losses in the system.

S.N	DG
1	3039.533
2	369.5

Table 1: Shows the Optimal Capacity of DGs

Fig 3 shows the per unit bus voltage profiles before and after installing DGs in the system network.

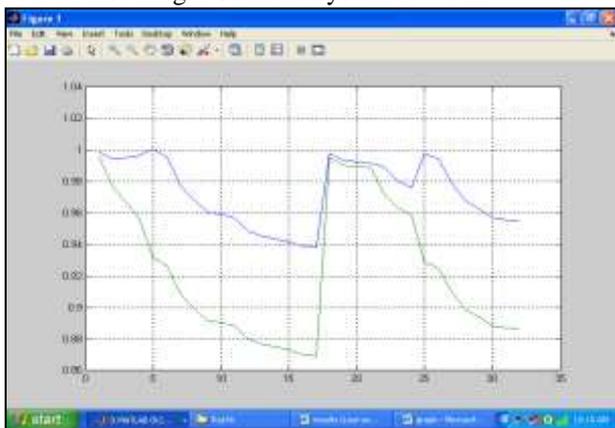


Fig. 2: Bus Voltage before and After Installing DGs in the System Network

Fig. 4 and 5 shows the active and reactive power flow after distributed generator installation

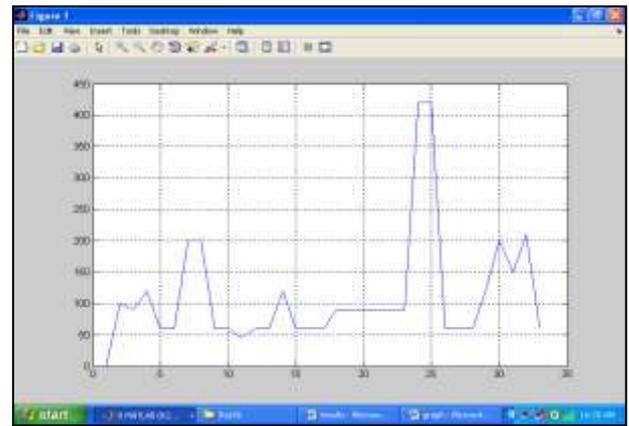


Fig. 3: Active Power flow after DG Placement

The effects of the significant parameters have been shown. From the result it is clear that there is optimal enhancement in the system parameters. The voltage profile is improved and power loss is minimized.

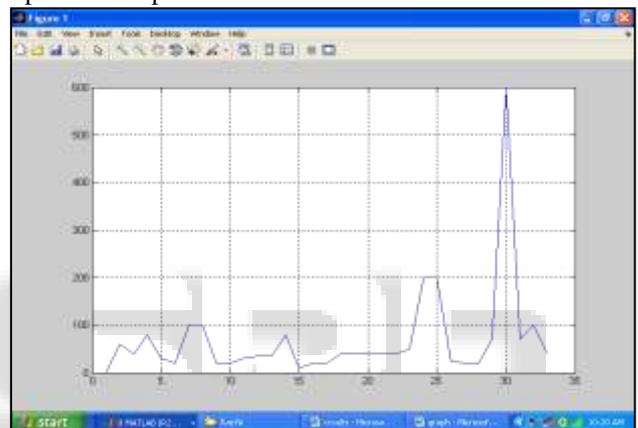


Fig. 4: Reactive Power Flow after DG Placement

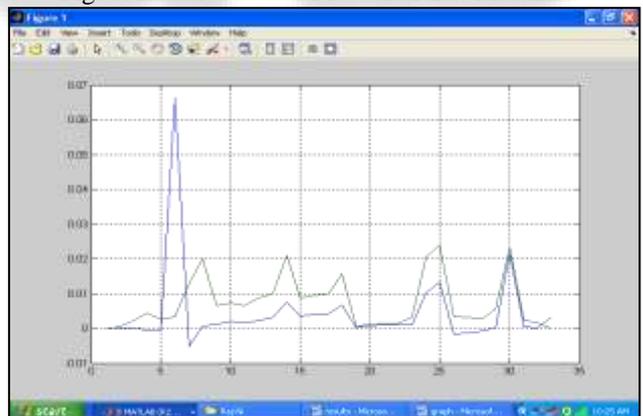


Fig. 5: Power Loss at Different Lines

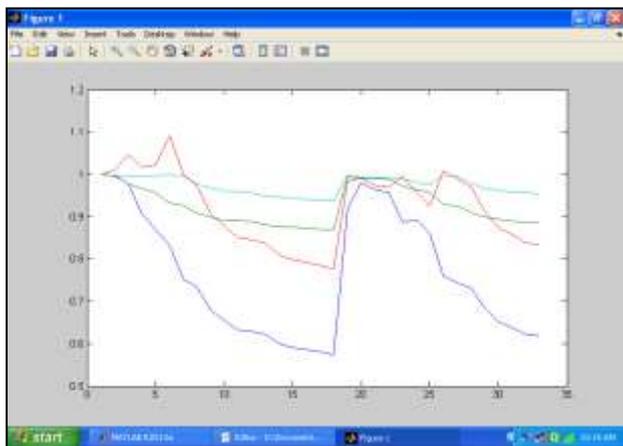


Fig. 6: Voltage Profile with DG & Without DG for all Cases

The voltage profile is improved and power loss is minimized. The proposed method uses many possible significant parameters into account to be optimized. The optimal number of DGs to be connected in the system was identified as 2 and the power loss was reduced. Hence, the system performance is improved.

II. CONCLUSION

In this Thesis, optimal placing of DG using forward sweep algorithm was tested for a IEEE 33 bus test system. The effects of the significant parameters have been shown. From the result it is clear that there is optimal enhancement in the system parameters. The proposed method is implemented using MATLAB 2013b and tested for IEEE 33 bus system. Which is shown in Figure The optimal number of DGs to be connected in the system identified is found to be 2 for 3039.533 W & 369.5 W each rating. Table shows the optimal capacity of Distributed Generation. It is clear that, the total Active power loss at without DG is 0.531(PU) and the total active power loss after connecting the optimal number of DGs in the system is 0.139(PU) Thus there is a reduction by about 39.92 % of total power losses in the system.

REFERENCES

[1] K. A. Birt, J. J. Graffy, J. D. McDonald, and A. H. El-Abiad, "Three phase load flow program," IEEE Trans. Power Appar. Syst., vol. PAS-95, pp. 59–65, Jan. /Feb. 1976

[2] T.-H. Chen, M.-S.Chen, K.-J. Hwang, P. Kotas, and E. A. Chebli, "Distribution system power flow analysis—A rigid approach," IEEE Trans. Power Delivery, vol. 6, pp. 1146–1152, July 1991.

[3] R. D. Zimmerman and H. D. Chiang, "Fast decoupled power flow for unbalanced radial distribution systems," IEEE Trans. Power Syst., vol. 10, pp. 2045–2052, Nov. 1995.

[4] W. M. Kersting and L. Willis, "Radial Distribution Test Systems, IEEE Trans. Power Syst.," vol. 6, IEEE Distribution Planning Working Group Rep., Aug. 1991.

[5] C. S. Cheng and D. Shirmohammadi, "A three-phase power flow method for real-time distribution system analysis," IEEE Trans. Power Syst., vol. 10, pp. 671–679, May 1995.

[6] D. Shirmohammadi, H. W. Hong, A. Semlyen, and G. X. Luo, "A compensation-based power flow method for weakly meshed distribution and transmission networks," IEEE Trans. Power Syst., vol. 3, pp. 753–762, May 1988.

[7] T. S. Chen, M. S. Chen, T. Inoue, and E. A. Chebli, "Three- phase co-generator and transformer models for distribution system analysis," IEEE Trans. Power Delivery, vol. 6, pp. 1671–1681.2, Oct. 1991.

[8] G. X. Luo and A. Semlyen, "Efficient load flow for large weakly meshed networks," IEEE Trans. Power Syst., vol. 5, pp. 1309–1316, Nov. 1990.

[9] W. M. Lin and M. S. Chen, "An overall distribution automation structure," Elect. Power Syst. Res., vol. 10, pp. 7–19, 1986

[10] S. Ghosh, D. Das, "Method for load-flow solution of radial distribution network", IEE Proc.-Gener. Transm. Distrib., vol. 146, no. 6, Nov. 1999.

[11] W. H. Kersting, Distribution System Modeling and Analysis, FL, Boca Raton: CRC Press, 2002.

[12] D. Shirmohammadi, H. W. Hong, A. Semlyen, G. X. Luo, "A compensation-based power flow method for weakly meshed distribution and transmission networks", IEEE Trans. Power Syst., vol. 3, no. 2, pp. 753-762, May 1988.

[13] W. H. Kersting, "Radial distribution test feeders – IEEE distribution planning working group report", IEEE Trans. Power Syst., vol. 6, no. 3, pp. 975-985, Aug. 1991.

[14] D. Shirmohammadi, H. W. Hong, A. Semlyen, G. X. Luo, "A compensation-based power flow method for weakly meshed distribution and transmission networks", IEEE Trans. Power Syst., vol. 3, no. 2, pp. 753-762, May 1988.

[15] W. H. Kersting, "Radial distribution test feeders – IEEE distribution planning working group report", IEEE Trans. Power Syst., vol. 6, no. 3, pp. 975-985, Aug. 1991.

[16] Prommee, W., W. Ongsakul. Optimal Multi-Distributed Generation Placement by Adaptive Weight Particle Swarm Optimization. in International Conference on Control, Automation and Systems. 2008. Seoul, Korea.

[17] AlRashidi, M.R., M.E. El-Hawary, A Survey of Particle Swarm Optimization Applications In Electric Power Systems. IEEE Transactions On Evolutionary Computation, 2009. 13(4): P. 913-918.

[18] G. Pepermans, J. Driesen, D. Haeseldonckx, W. D'haeseleer And R. Belmans "Distributed Generation: Definition, Benefits And Issues" Katholieke Universiteit Leuven, 19 August 2003.

[19] Ault, G., W.; "A Planning and Analysis Framework for Evaluating Distributed Generation and Utility Strategies;" PhD Thesis, September 2000, Centre for Electrical Power Engineering, Department of Electronic and Electrical Engineering, University of Strathclyde.