

Effect of Spiral Coil on Heat Transfer in Double Pipe Heat Exchanger-A Review

R. R. Bilawane¹ Sahil S. Pabbewar² Suraj B. Vishwakarma³ Harshal A. Bhure⁴ Lokesh S. Godewar⁵

¹Assistant Professor ^{2,3,4,5}Student
^{1,2,3,4,5}Department of Mechanical Engineering
^{1,2,3,4,5}Nagpur Institute of Technology, Nagpur(MH), India

Abstract— Nowadays heat exchanger is the most effective mean to interchange thermal energy of one fluid to other. This is done by using miscellaneous techniques which improves heat transfer rate includes active, passive and compound augmentation techniques. In most of the mechanical process industries, heat exchanger is the principal device used for heat transfer phenomenon. The present article is about the review on research work has been done on various augmentation technique used to enhance the heat transfer rate in last decade. This paper contains literature estimation of heat transfer enhancement using spiral inserts. The present paper gives the theoretical as well as practical analysis of double pipe heat exchanger using spiral coil. This investigation is carried out to improve thermal performance of double pipe heat exchanger. The heat exchanger includes two copper pipes of diameter 25.4 mm and 50.8 mm with spiral coil of 4 mm diameter. In this experiment, water used as a working fluid in which hot fluid inlet temperature extend from 50°C to 80°C and cold fluid inlet temperature is kept at 30°C. This testing carry through hot water and cold water mass flow rate vary from .The theoretical analysis of project work has been accomplished with the use of Ansys software, which helps in CFD analysis.

Keywords: Spiral Coil, Passive Method, Double Pipe Heat Exchanger, Heat Transfer Coefficient, Turbulence

I. INTRODUCTION

Heat exchanger is a device used to exchange the heat from one fluid (hot fluid) to another fluid (cold fluid) with or without direct contact at different temperature. This exchange of heat takes place either to remove the heat from a fluid or to add heat to a fluid. For example, the heat exchanger used to remove the heat from the fluid is known as condenser or the heat exchanger used to add the heat to a fluid is known as boiler. Heat exchangers are broadly used in the refrigeration and air conditioning, petrochemical plants, sewage treatment, refineries, pharmaceuticals, food beverage and dairy industries, automobile radiators. According to application heat exchangers are classified on the basis of design features, nature of heat exchange process, relative direction of fluid motion and physical state of fluids.

A. Sorting of Augmentation Techniques

In general, Augmentation Techniques are categorized into three different techniques:

- Active
- Passive
- Compound

B. Active Technique

The technique used to enhance the heat transfer rate by applying external power input is known as active augmentation technique.

C. Passive Technique

This method is used to create turbulence in the path of fluid flow by using inserts in tube. This turbulence in fluid flow increases the heat transfer rate from one fluid to other.

D. Compound Technique

In this case, combination of two methods is used to raise the heat transfer rate. The result obtained is greater than using any one technique individually.

II. LITERATURE REVIEW

Some experimental investigation has been done on double pipe heat exchanger using spiral coil for the enhancement of the heat transfer. Most of the industrial researchers as well as academic researchers contributed in this field, the review of the research work carried out in this area are as follows:

Jay J. Bhavsar, V K. Matawala, S. Dixit [1], they did the experimental analysis on spiral tube heat exchanger over the shell and tube heat exchanger. They concluded that with the use of spiral tube by varying mass flow rate of working fluid, the temperature of hot fluid decreases at the exit with increasing in mass flow rate of cold fluid. For the performance of the experiment they used hot oil and cold water as a working fluid. A coil is fabricated by bending the 12mm diameter copper tube into spiral coil of four turns. The investigation had done on the mass flow rate of working fluid i.e cold water and hot oil which ranges in the middle of 0.075 and 0.25 kg/s, and between 0.008 and 0.04 kg/s. The temperature of cold water and hot oil at the inlet had between 29 and 37°C and between 70 and 56°C.

N.C kanojiya , V.M Kriplani , P.V Walke [2] , they did the review on heat transfer enhancement in heat exchangers with inserts ,they concluded that if the swirl flow is generated by passive method using perforated twisted tape inserts and nanofluid, the heat transfer rate as well as heat transfer coefficient and friction factor increases while decrease in pressure drop takes place . It was shown that used of inserts in heat exchanger was beneficial for the heat transfer enhancement.

Kartik M. Vyas, Rajdip J. Gohil, Neel S. Patel, Prof. Mitesh B. Lalwani [3] , gives the thermal analysis of tube in tube liquid spiral heat exchanger over shell and tube heat exchanger. A two copper pipes had used in the fabrication of the experimental set up in which ½” copper pipe used as a inner tube and 1” copper pipe used as outer tube , both the coil had shaped into spiral form to fabricate

the setup of tube in tube heat exchanger. They used water as a working fluid. During the experimental analysis, the result obtained had the effectiveness of 33.80% in case of parallel flow and 40% in counter flow. By using tube in tube heat exchanger, more turbulence had offered to flow and better effectiveness can be obtained.

Suman Shah, K. Kiran Kumar, they carried out the experimental study and heat transfer analysis on copper spiral heat exchanger using water based SiO₂ nanofluid as a coolant.

Nikhil Lokhande, Dr. S. R. Nikam, Dr. K.N. Patil , had comparatively analysis the spiral heat exchanger and gasketed plate type heat exchanger using stainless steel as a material for plate making of plate heat exchanger with thermal conductivity 16.2 W/mK. This investigation concluded that the performance of gasketed plate heat exchanger was better than spiral plate heat exchanger, by using gasketed plate heat exchanger the overall heat transfer coefficient increased by 86.8% over spiral plate heat exchanger. The experimental investigation of plate heat exchanger had done on two different plate chevron angles , 65° and 30° in which it was found that the overall heat transfer coefficient increased by 26% in case of 65° chevron angle as compared to 30°.

Ruchal G. Humbare, Suraj R. Gurav, S. B. Trimbake , had gone through the comparative study between helical coil heat exchanger and straight tube heat exchanger for parallel flow and counter flow. The overall heat transfer coefficient increases with flow rate in case of helical coil heat exchanger and 10 to 20% more than that of straight tube heat exchanger. Effect of curvature ratio and pitch of helical coil had shown as the curvature ratio increases, the heat transfer coefficient also increases while the pitch increases the overall heat transfer coefficient decreases.

E.I. Jassim, did the experimental study on transient natural convection heat transfer from spiral coil in a spiral coil heat exchanger. He had compare the efficiency of spiral coil heat exchanger in horizontal as well as in vertical position of spiral coil in which he found that spiral coil in vertical position had shown more effectual than horizontal position in terms of transferring heat. He also found that by increasing number of loops of spiral coil per unit length could improve the heat transfer rate.

III. PROPOSED WORK

The purpose of present study is to examine experimentally the effect of spiral coil on heat transfer in double pipe heat exchanger. The overview of experimental set-up is as follows:

SN	Elements	Dimension
1	Outer Plain Tube	D =50.8 mm, L=700 mm
2	Inner Plain Tube	D=25.4 mm , L=800 mm
3	Inner Spiral Coil	D=4 mm, L=700 mm , No. of loops= 18
4	Pitch	40 mm
5	Material	Copper
6	Thermal conductivity	385 W/mk
7	Thermocouple	PT 100
8	Thickness	2 mm

Table 1: Specification of Experimental Set-up

A. Heat Exchanger Line Diagram

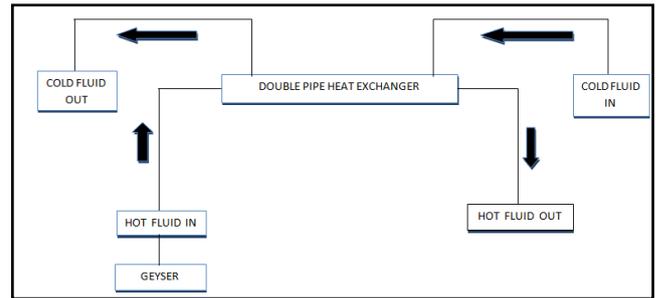


Fig. 1: Schematic View of Heat Exchanger

B. Experimental Procedure

- Experiments have been studied by varying input parameters like mass flow rate of cold water as well as hot water and input temperature of hot water.
- The mass flow rates used in experimentation is 0.0167 kg/sec for both cold and hot water.
- The inlet temperatures of hot water have been varied from 45°C to 70 °C i.e. 45°C, 50°C, 60°C, 65°C, and 70 °C.
- These input temperatures were achieved by controlling power input given to the water geyser. This power is controlled by dimmer stat. Input temperature of 50°C.
- Cold water is kept 27°C and 30 °C throughout the experimentation which have been taken directly from tap.
- Results are taken at steady state condition. Above experimental procedure are repeated for with spiral coil and without spiral coil for counter flow as well as parallel flow heat exchanger.

IV. CONCLUSION

From this review, lot of research has been done on improvement in heat transfer rate in the heat exchangers. Numerous possible methods are used for heat transfer enhancement by implementing passive augmentation techniques which incorporate the usage of different types of inserts. The research done by E.I. Jassim concluded that heat transfer coefficient increases with increases in loops of spiral coil .With the spiral coil insert , rate of heat transfer increases consequently heat transfer coefficient also increases with decreases in pressure drop as compared to without using spiral coil insert. With the conclusion, uses of inserts are advantageous in the enhancement of heat transfer rate in the heat exchangers.

ACKNOWLEDGEMENT

We would like to express our sincere thanks to Prof. Riddheshwar R. Bilawane, Assistant Professor of Department of Mechanical Engineering, Nagpur Institute of Technology, Nagpur for his guidance and support during the project.

We would like to extend our gratitude to Dr. Nitin K. Mandavgade, Head of Mechanical Engineering Department, Nagpur Institute of Technology, Nagpur for

providing the facility required at Heat Transfer Lab and Workshop to complete the project.

REFERENCES

- [1] E.I. Jassim “Spiral Coil Heat Exchanger – Experimental Study”. 3rd International Conference on Fluid Flow, Heat and Mass Transfer (FFHMT’16), Ottawa, Canada – May 2 – 3, 2016.
- [2] Jay J. Bhavsar, V K. Matawala, S. Dixit “Design & Experimental Analysis of Spiral Tube Heat Exchanger”. International Journal of Mechanical & Production Engineering, (IJMPE) ISSN: 2320-2092, Volume-1, Issue-1, July-2013.
- [3] Kartik M. Vyas¹, Rajdip J. Gohil², Neel S. Patel³, Prof. Mitesh B. Lalwani⁴ “Thermal Analysis of Tube in Tube Liquid –Liquid Spiral Heat Exchanger”. International Research Journal of Engineering and Technology (IRJET), e-ISSN: 2395-0056 p-ISSN: 2395-0072 Volume: 05 Issue: 05 | May-2018.
- [4] N.C. Kanojiya , V.M. Kriplani , P.V. Walke “ Heat Transfer Enhancement in Heat Exchangers With Inserts ”.International Journal of Engineering Research & Technology (IJERT) ISSN:2278-0181, Vol. 3 Issue 10 ,October-2014.
- [5] Nikhil Lokhande, Dr. S. R. Nikam, Dr. K.N. Patil “Comparative Analysis Of Spiral Heat Exchanger And Gasketed Plate Type Heat Exchanger” Journal Of Emerging Technologies And Innovative Research (JETIR) Ssn-2349-5162) ,October 2017, Volume 4, Issue 10.
- [6] Ruchal G. Humbare, Suraj R. Gurav, S. B. Trimbake “Analysis of Heat Transfer Enhancement in Tube-in-tube Helical Coil Heat Exchangers”. International Journal of Engineering and Advanced Technology (IJEAT) ISSN: 2249 – 8958, Volume-5 Issue-1, October 2015.
- [7] Suman Shah, K. Kiran Kumar “Experimental Study & Heat Transfer Analysis on Copper Spiral Heat Exchanger Using Water Based SiO₂ Nanofluid as Coolant”. World Journal of Nano Science and Engineering, 2018, 8, 57-68, ISSN Online: 2161-4962 ISSN Print: 2161-4954.